


5.6.4 Drg. Nō. 12-001275, 10W PA Circuit Diagram

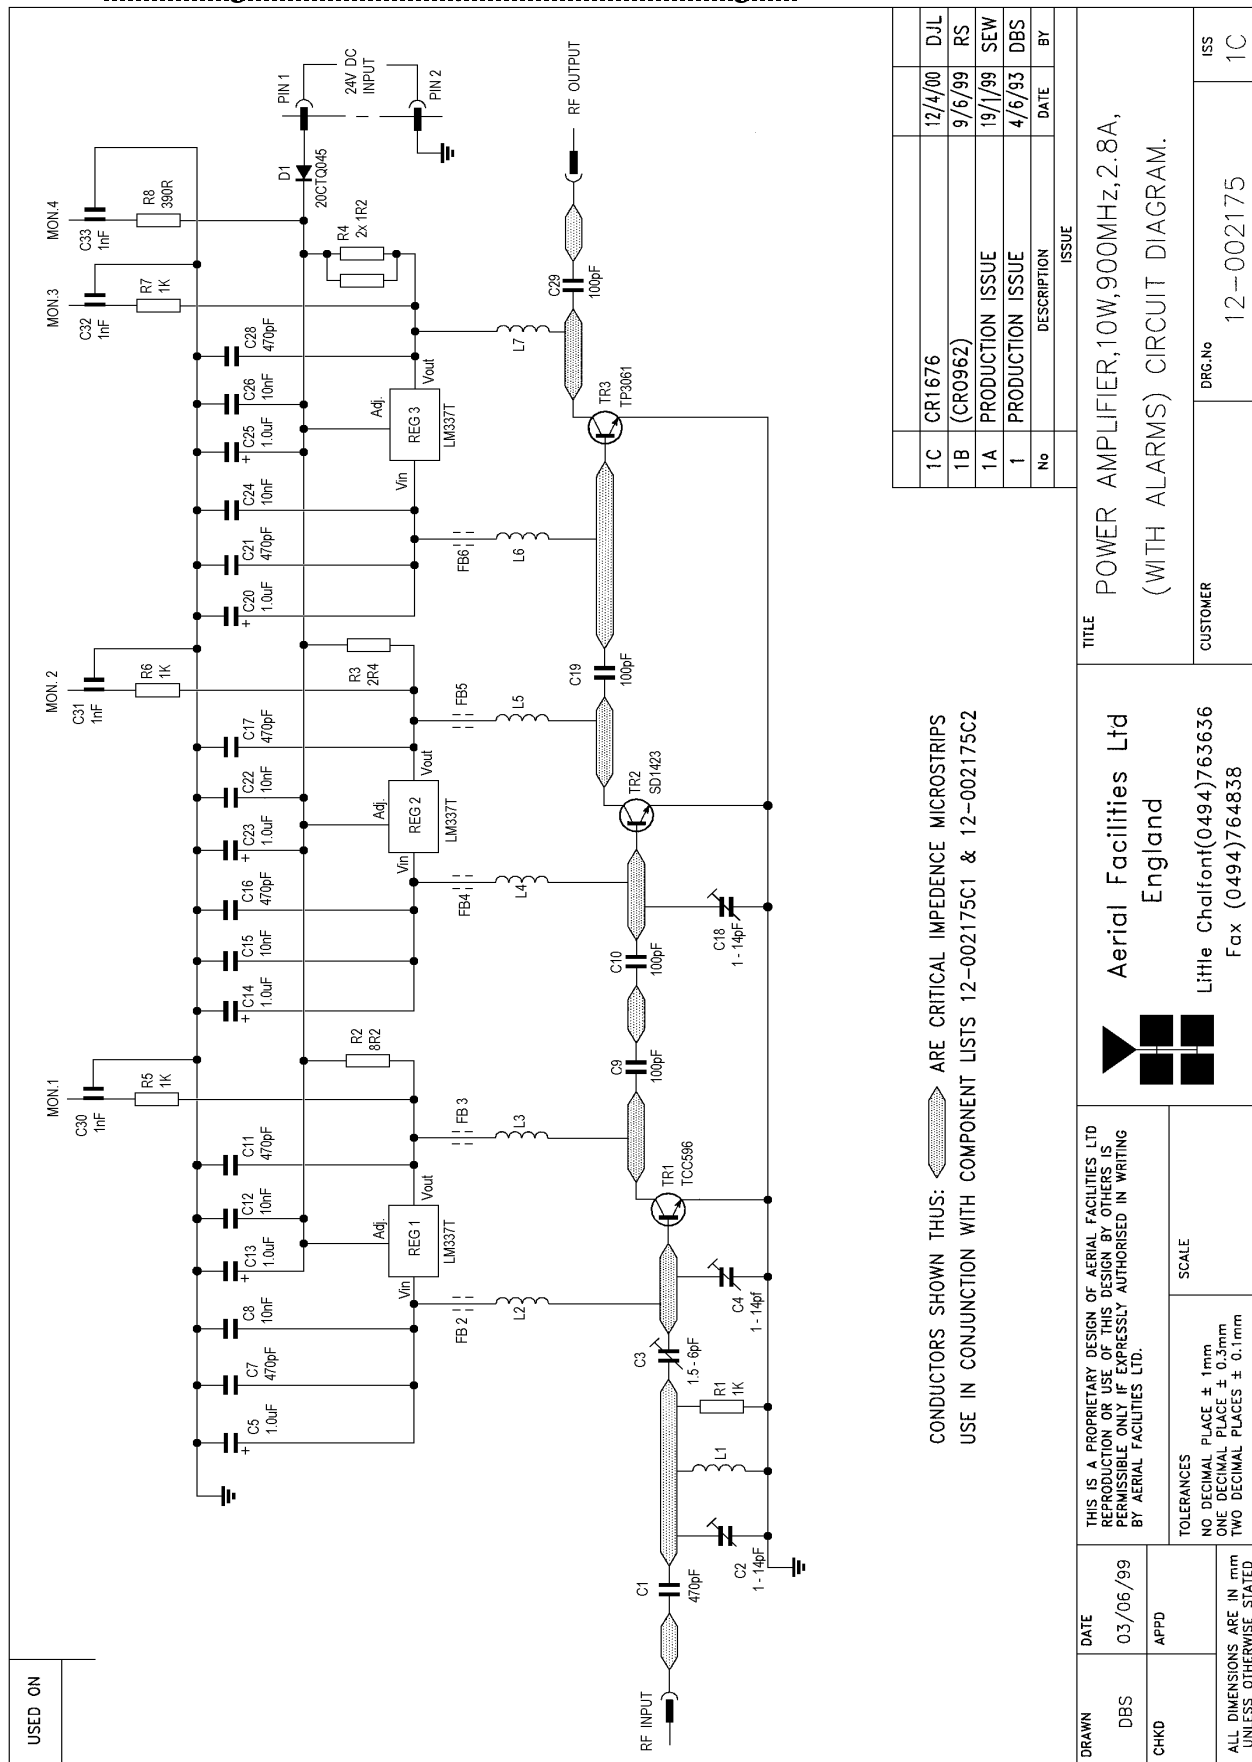

Aerial Facilities Limited

www.AerialFacilities.com

Technical Literature

800MHz BDA (Pasadena Figuero Tunnel)
Maintenance Handbook


H/book Number:-60-056100HBKM

Issue No:-1

Date:-15/10/2003

Page:-30 of 52

5.6.7 Drg. Nō. 80-008450, PA Alarm Wiring Details

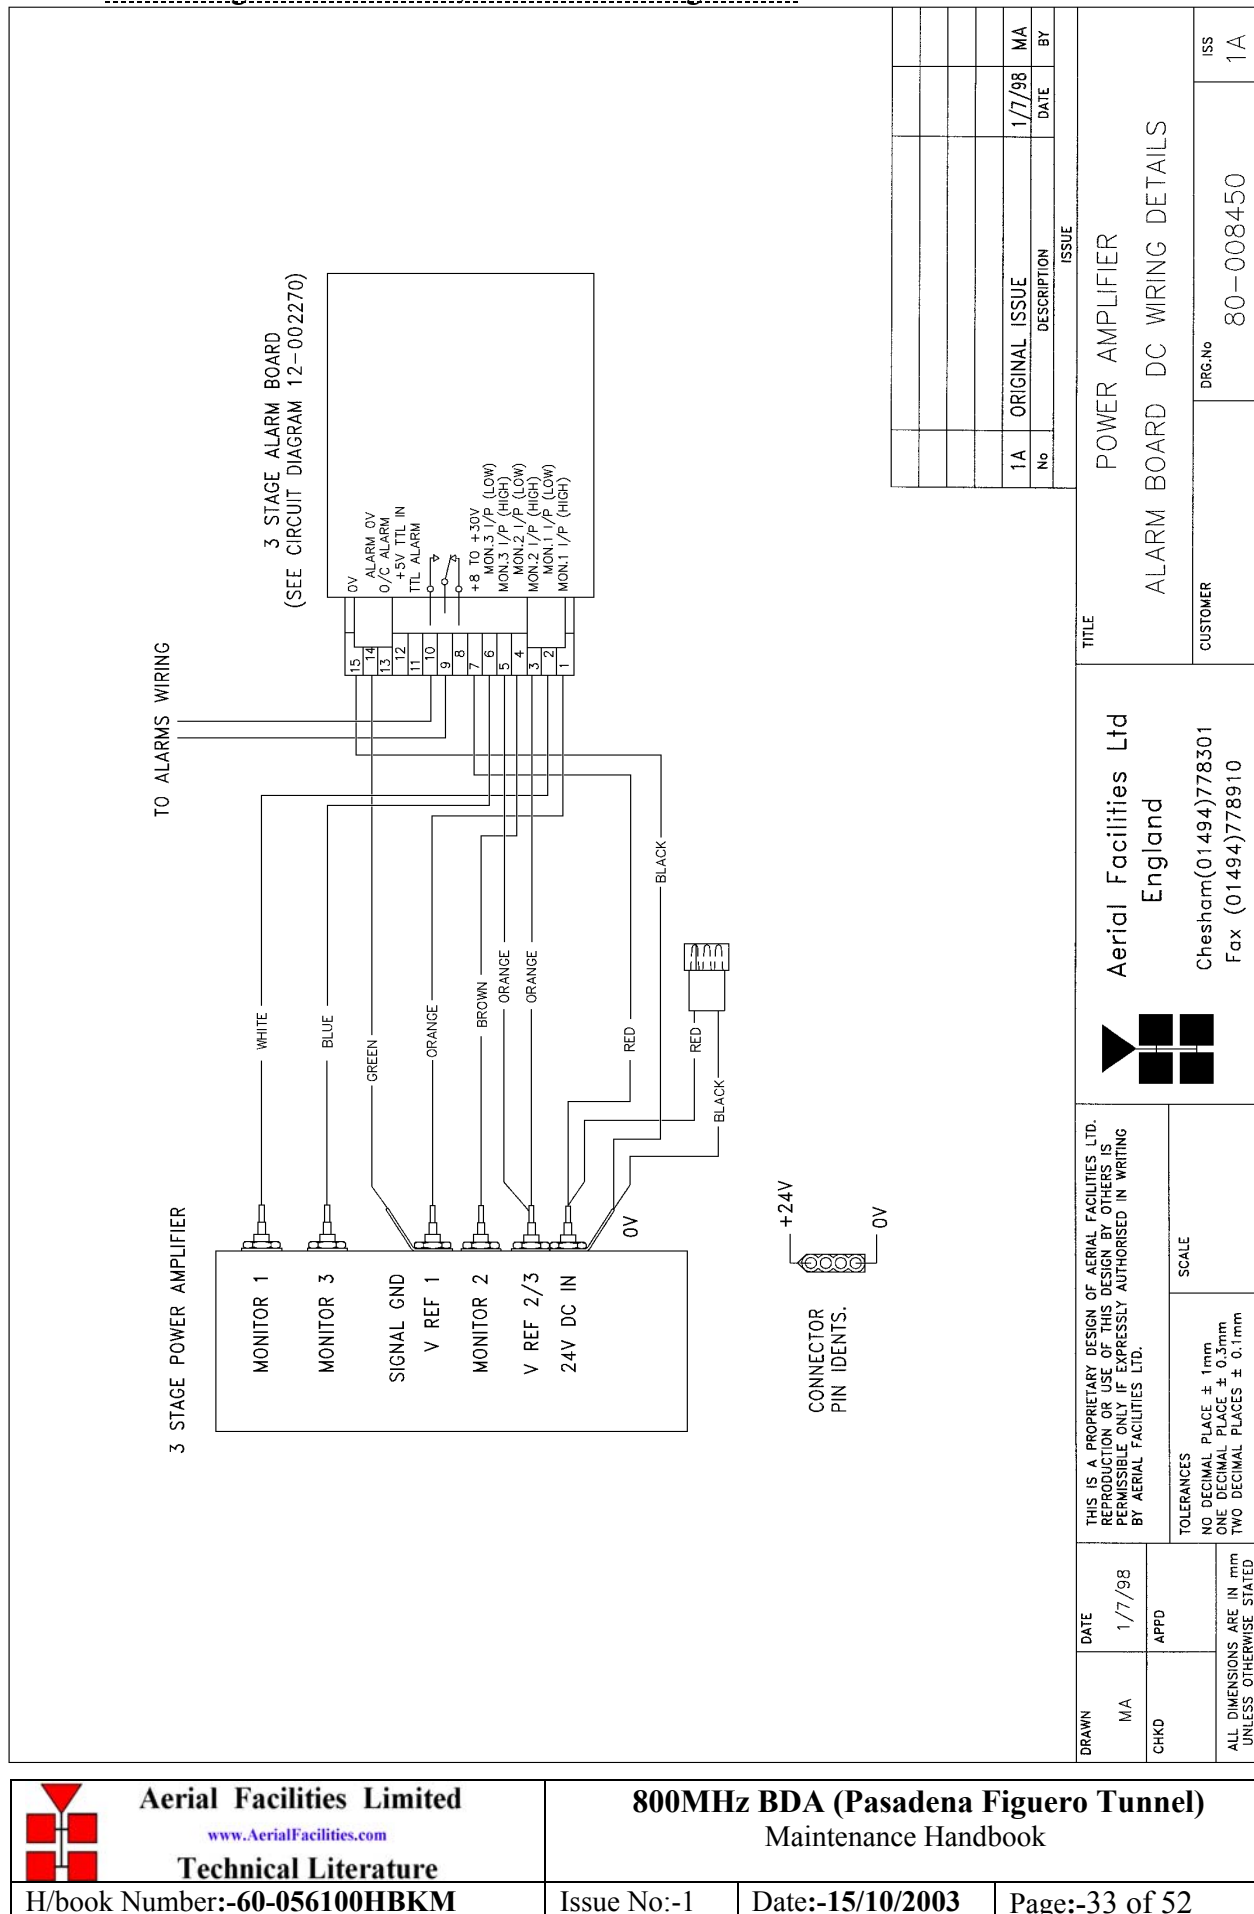

Aerial Facilities Limited
www.AerialFacilities.com
Technical Literature

800MHz BDA (Pasadena Figuero Tunnel)
Maintenance Handbook


H/book Number:-60-056100HBKM

Issue No:-1

Date:-15/10/2003

Page:-33 of 52

5.7.4 Drg. Nō. 12-002270, 3 Stage Alarm Board Circuit Diagram

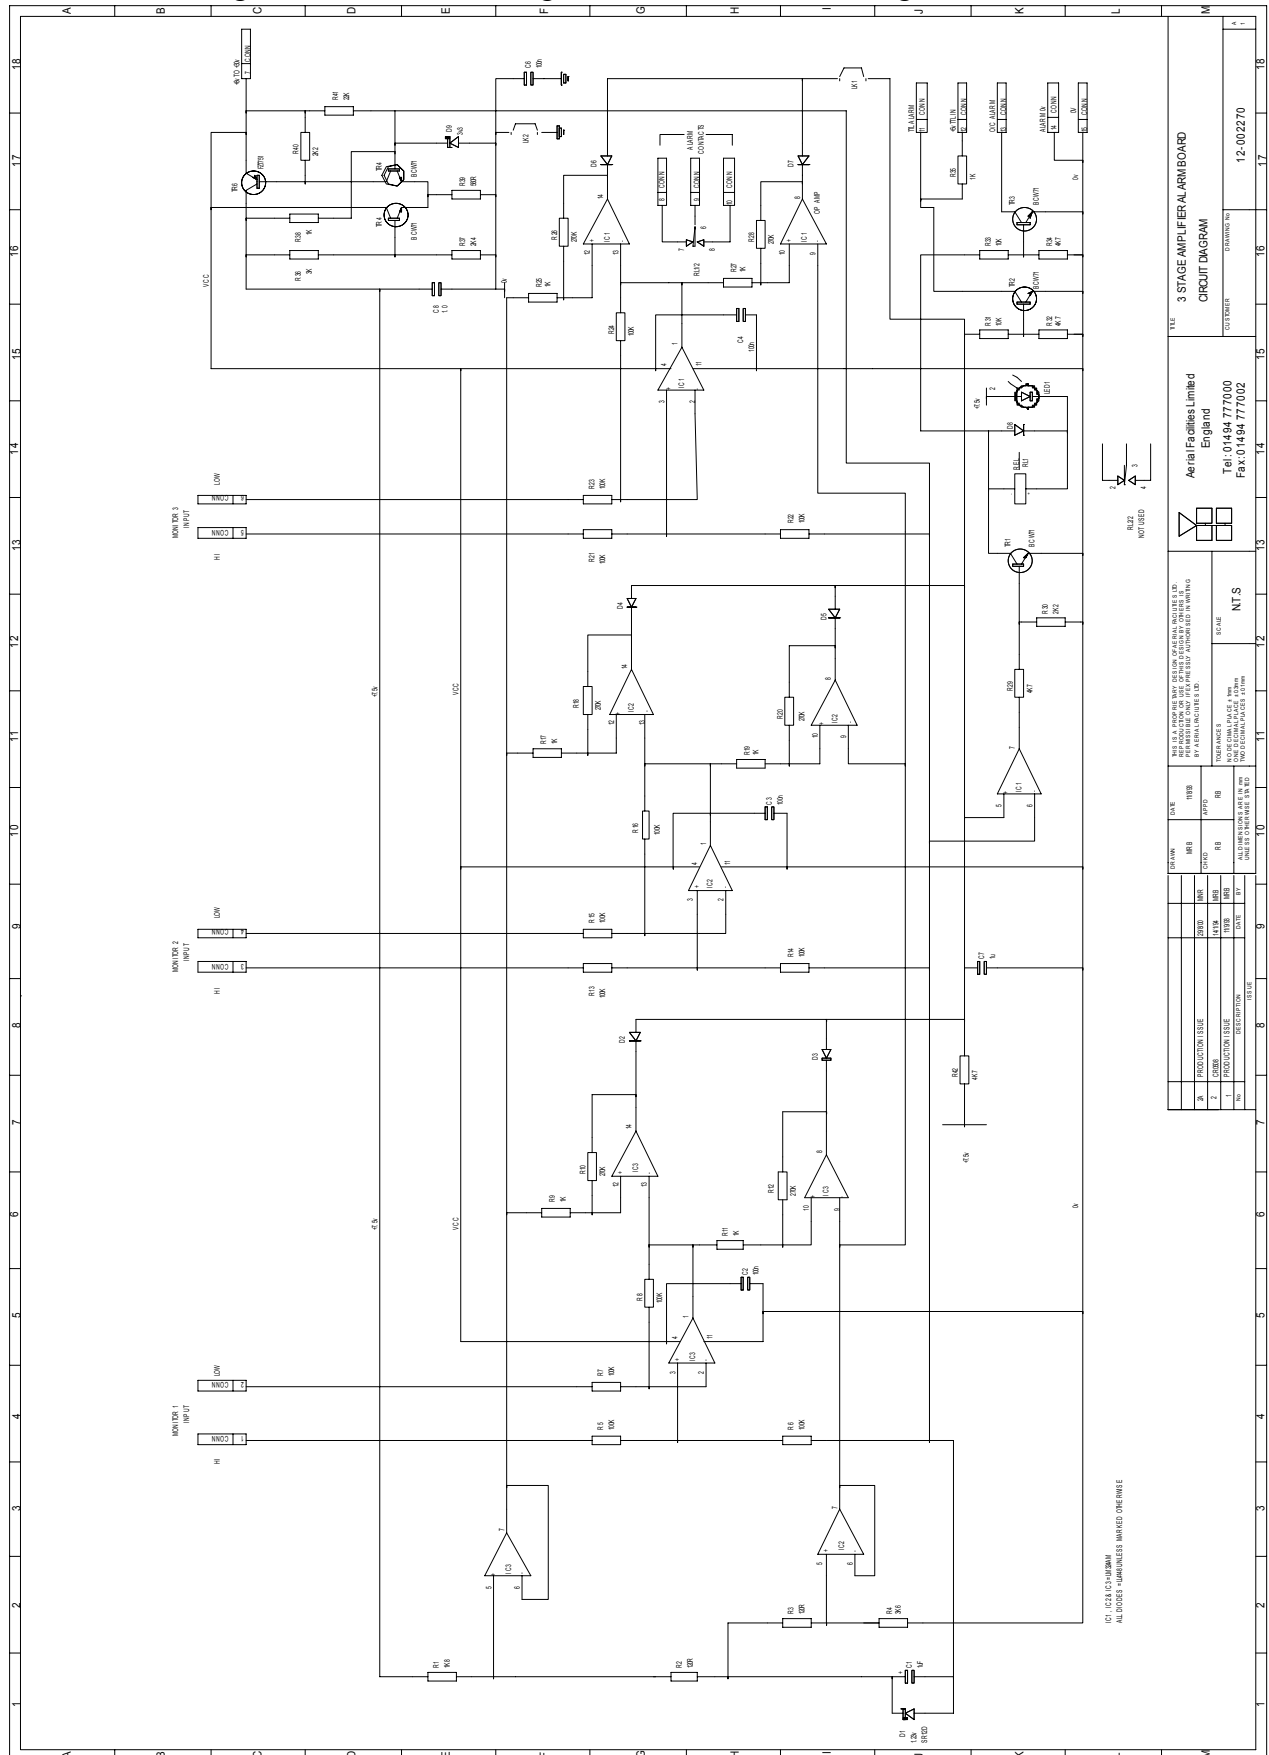

Aerial Facilities Limited

www.AerialFacilities.com

Technical Literature

800MHz BDA (Pasadena Figuero Tunnel)
Maintenance Handbook

H/book Number:-60-056100HBKM

Issue No:-1

Date:-16/10/2003

Page:-37 of 52