


Label Artwork and Location

Model: CR8009B-GLC

Label:

 CAUTION RISK OF ELECTRIC SHOCK DO NOT OPEN		CROSLEY® Model : CR8009B-GLC Replacement Needle: NP-6
CAUTION: TO REDUCE THE RISK OF ELECTRIC SHOCK, DO NOT REMOVE COVER(OR BACK). NO USER SERVICEABLE PARTS INSIDE. REFER SERVICING TO QUALIFIED SERVICE PERSONNEL.		POWER SUPPLY: AC adapter(DC 5V 1A) POWER CONSUMPTION:9W This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) This device must accept any interference received. Including interference that may cause undesired operation.
WARNING TO PREVENT ELECTRIC SHOCK DO NOT REMOVE BACK COVER NO USER SERVICEABLE PARTS INSIDE.		California 93120 compliant for formaldehyde FCC ID: AUSCR8009TM
⚠ WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov. For more information go to www.CrosleyBrands.com/Compliance/Prop65		MADE IN CHINA S/N: 572260621

Size: L*W=170*80mm

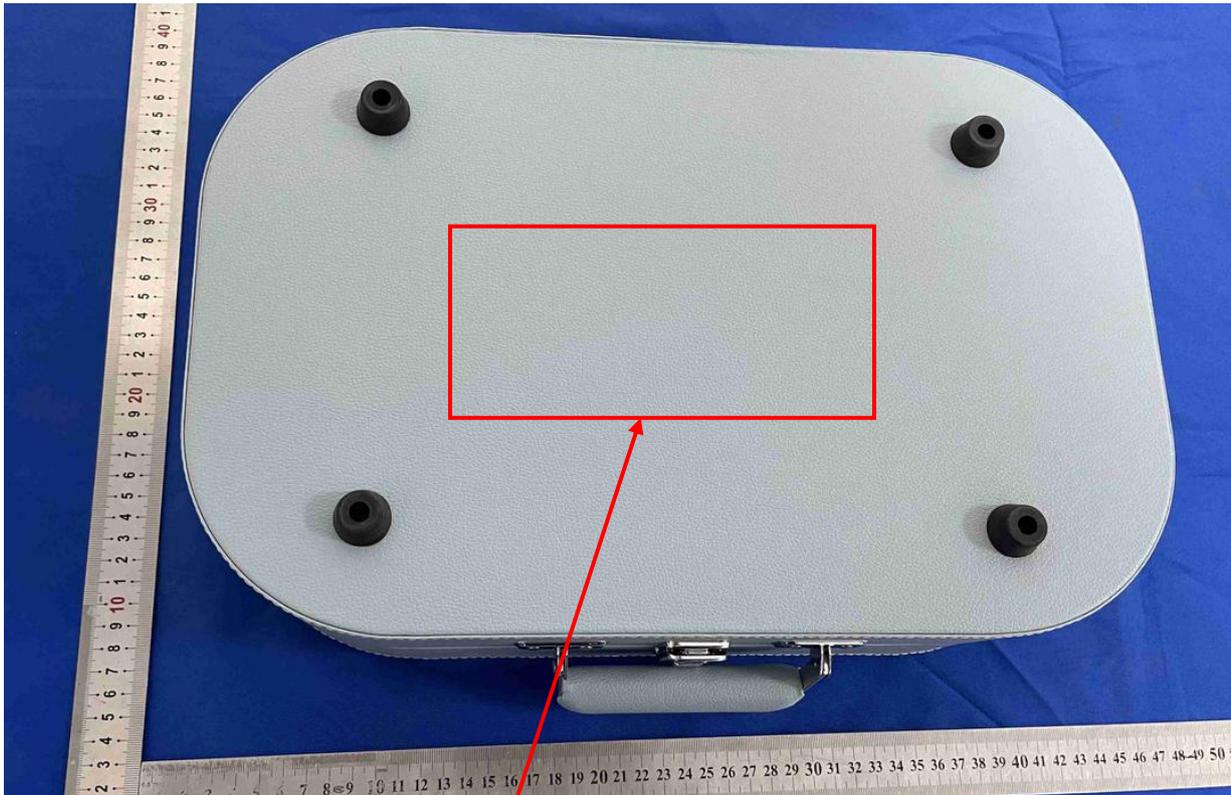

Location