

acknowledgement

SPECIFICATION FOR APPROVAL

CUSTOMER:Zhejiang Shiwanke Electric Appliance Co., LTD

CUST P/N:

FINE P/N:G50*1.0-20.5-0.08*105P-10T-6.4UH-W42-L80MM+BJ

DESC:Φ 50MMX1.0MM

DATE:2025/03/27

Version:A.0

PREPARED BY	CHECKED BY	APPROVED BY	CUSTOMER APPROVE
He Licheng	Mary	Dankoclear	

Dongguan Yinze electronic technology Co., LTD

Factory address: No. 901, Building 2, Xinghan Road, Chashan Town, Dongguan City


Dankoclear TEL: 18617251159

[illegible]

SPECIFICATION

DESC:	G50*1.0-20.5-0.08*105P-10T-6.4UH-W42-L80MM+BJ	Rev: A.0	CUST:	Zhejiang Shiwanke Electric Appliance Co., LTD
			CUST P/N:	

1. DIMENSION:(mm)

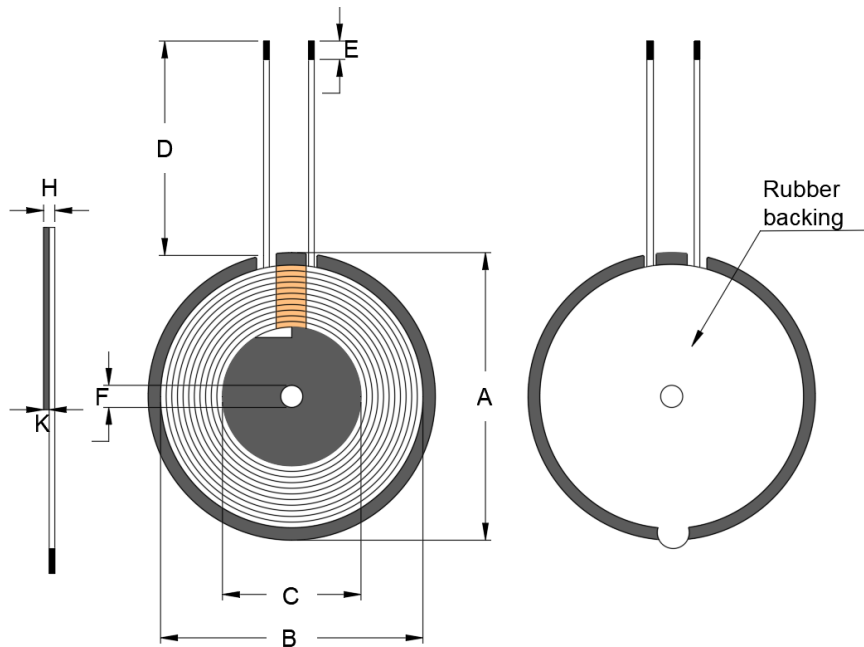

A	50±0.5
B	42±0.5
C	20.5±0.5
D	80 ±2
E	3±2
F	5.3±0.2
H	2.5±0.1
K	1.0±0.05
I	

note:

- 1.Cross out wire;
- 2.Coil attached 50 double slot diskette, Disc size 50 ±0.5mm, The thickness is 1.0±0.05mm.
- 3.Tape the back of the magnetic disc

2. SCHEMATIC DIAGRAM:



3、Winding Specification:

NO.	TERMINAL		WIRE	Turns	Winding Direction
1	S	F	Silk-covered wire 0.08*105P	10Ts	CCW

4、ELECTRICAL CHARACTERISTICS:

TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%

NO.	ITEM	TERMINAL	SPECIFICATION	TEST FREQUENCY	TEST EQUIPMENTS
1	IND.	S-F	3.7uH ±10% individual coil	100KHz/1.0V	LCZ METER 1062B
2	IND.	S-F	6.4uH ±10% plus diskettes	100KHz/1.0V	LCZ METER 1062B
3	DCR	S-F	≤40m Ω		LCZ METER 502B

PREPARED BY/DATE	CHECKED BY/DATE
------------------	-----------------

He Licheng 2025.03.27	
-----------------------	--