



802.11n HT20

Conducted band-edge / 2 412 MHz

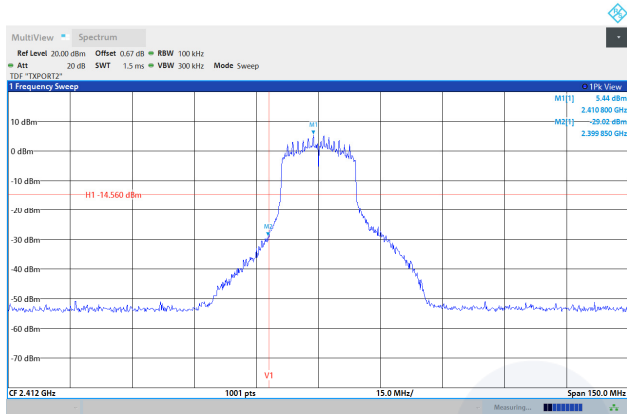


Conducted spurious / 2 412 MHz

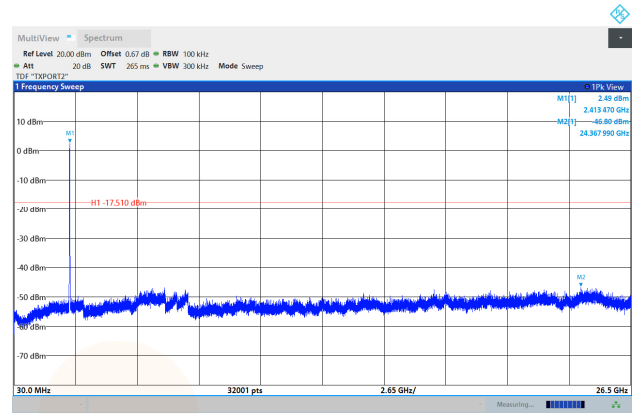


Conducted band-edge / 2 437 MHz

Blank


Conducted spurious / 2 437 MHz

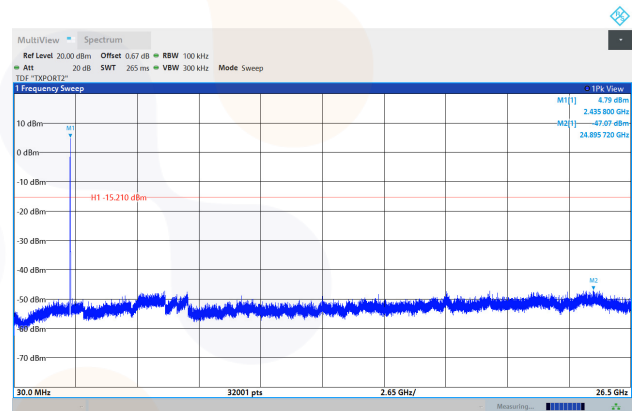

Conducted band-edge / 2 462 MHz

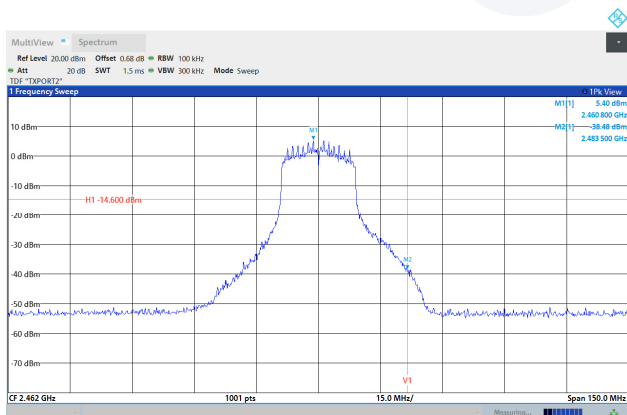


Conducted spurious / 2 462 MHz

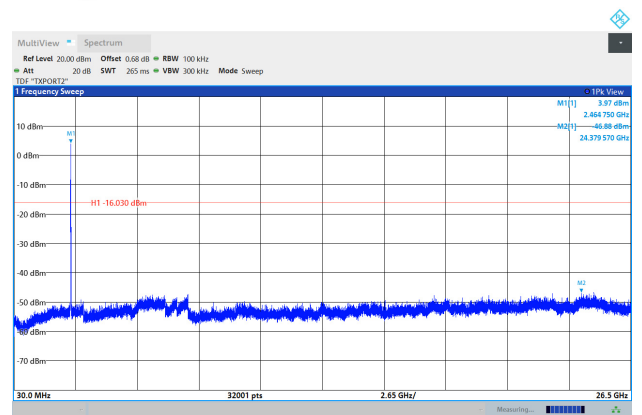


802.11ac VHT20

Conducted band-edge / 2 412 MHz

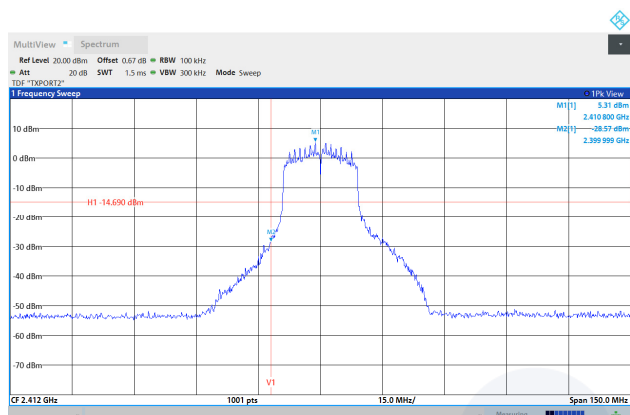


Conducted spurious / 2 412 MHz

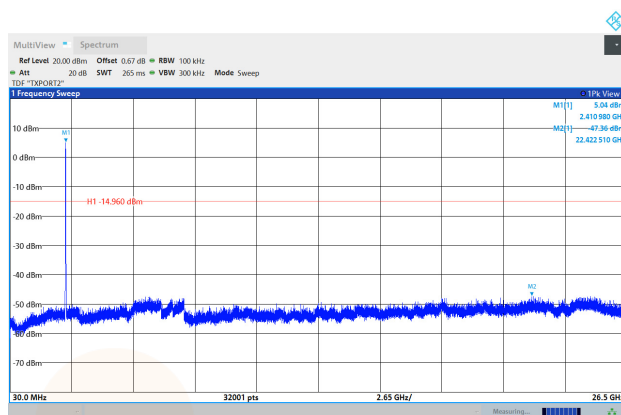


Conducted band-edge / 2 437 MHz

Blank


Conducted spurious / 2 437 MHz

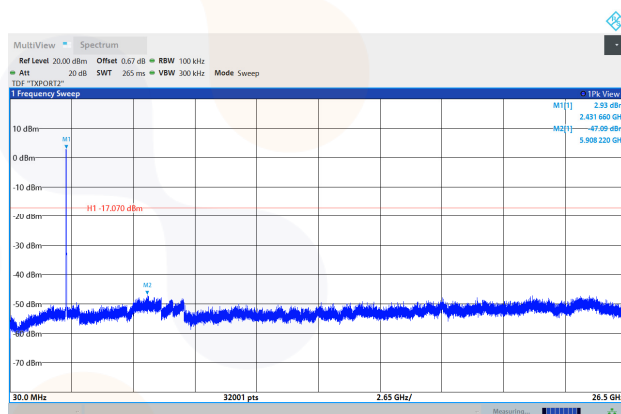


Conducted band-edge / 2 462 MHz

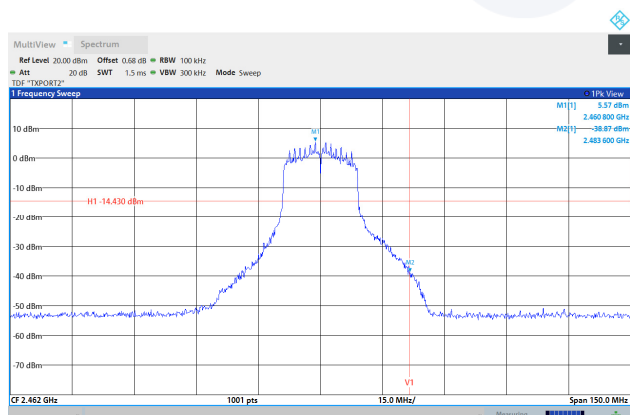


Conducted spurious / 2 462 MHz

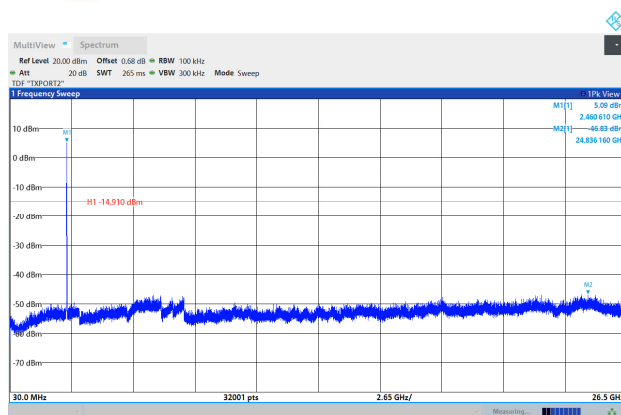


Conducted band-edge / 2 467 MHz

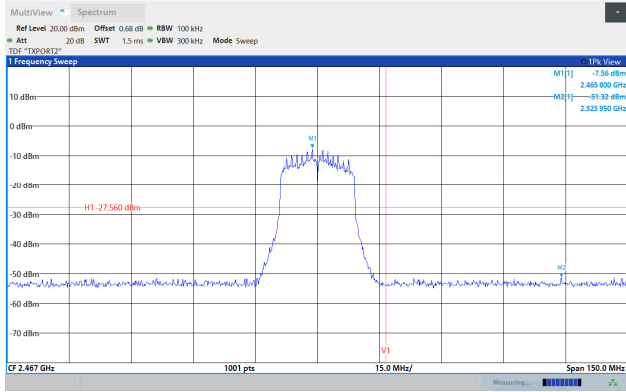


Conducted spurious / 2 467 MHz

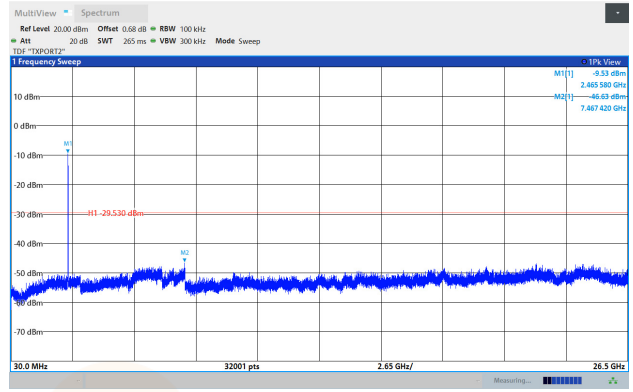

Conducted band-edge / 2 472 MHz

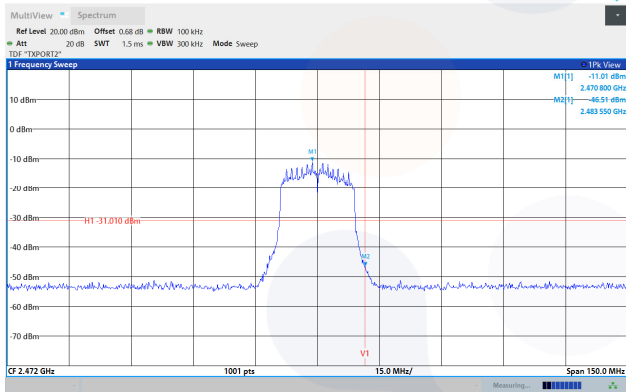

Conducted spurious / 2 472 MHz

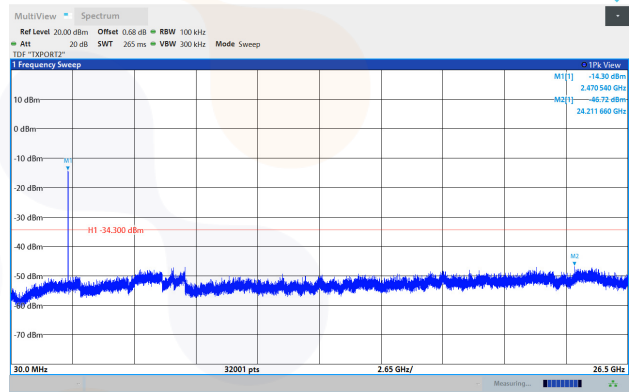

8. Measurement equipment

Equipment Name	Manufacturer	Model No.	Serial No.	Next Cal. Date
Controller	INNCO SYSTEMS	CO3000	1441/54370322/P	-
Antenna Mast	INNCO SYSTEMS	MA4640-XP-ET	AM003	-
Turn Device	INNCO SYSTEMS	DS1200-S-1t	0003	-
Antenna Mast	Innco Systems	MA4640-XP-ET	MA4000/396/3081 0213/L	-
Controller	Innco Systems	CO3000	1175/45850319/P	-
Spectrum Analyzer	R&S	FSV40	100988	25.05.27
Amplifier	SONOMA INSTRUMENT	310N	421910	25.10.11
Bilog Antenna	Teseq GmbH	CBL 6112D	61521	26.12.11
Loop Antenna	R&S	HFH2-Z2	100355	26.06.25
Vector Signal Generator	R&S	SMBV100A	257566	25.07.01
Spectrum Analyzer	R&S	FSVA40	101575	25.04.24
Broadband PreAmplifier	SCHWARZBECK	BBV9718D	57	26.01.16
Low Noise Amplifier	TESTEK	TK-PA18H	220124-L	25.10.11
Low Noise Amplifier	TESTEK	TK-PA1840H	220133-L	25.10.14
Horn Antenna	SCHWARZBECK	BBHA9120D	2763	25.10.24
Horn Antenna	SCHWARZBECK	BBHA9170	1267	25.10.15
High Pass Filter	QOTANA TECHNOLOGIES	DBHF0508004000A	23041800061	25.06.24
High Pass Filter	Wainwright Instruments GmbH	WHKX12-2805-3000- 18000-40SS	SN58	25.10.15
TWO-LINE V - NETWORK	R&S	ENV216	101358	25.10.13
EMI TEST RECEIVER	R&S	ESCI3	101428	25.08.12
Spectrum Analyzer	R&S	FSV40	100989	25.10.10
Horn antenna	ETS.lindgren	3117	00251528	26.01.21
AMPLIFIER	B&Z Technologies	BZR-0050400- 551028-252525	27736	25.06.24
Attenuator	API Inmet	40AH2W-10	12	25.04.30
Signal Generator	R&S	SMB100A	176206	26.01.17
Signal & Spectrum Analyzer	R&S	FSV3030	1330.5000K30- 101710-Wt	25.07.02
Attenuator	API Inmet	40AH2W-10	14	25.04.30
DC Power Supply	AGILENT	E3632A	KR94907664	25.04.24
Power Sensor	R&S	NRP-Z81	1137.9009.02- 106225-JM	25.04.24
Power Sensor	R&S	NRP-Z81	1137.9009.02- 106223-bB	25.04.24
Attenuator	HP	8491A	18591	26.01.17
Attenuator	HP	8491A	29738	25.10.10

*This equipment was calibrated during the test period, and was used after calibration.

End of test report