


EUT-2.

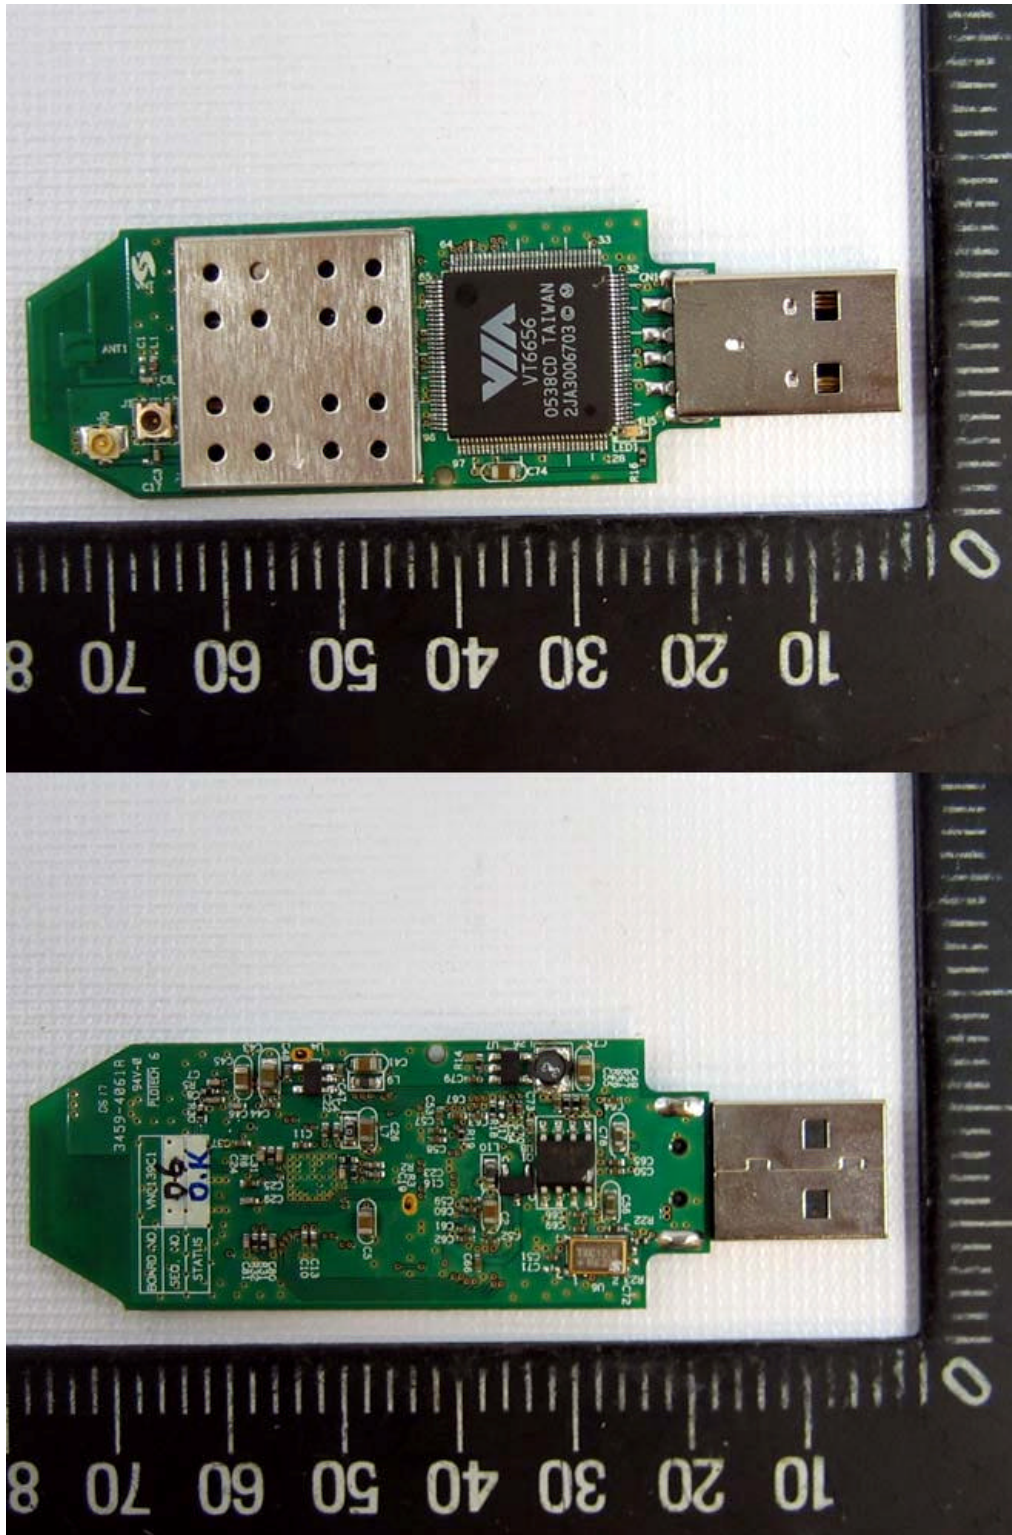


International Standards Laboratory

Report Number: ISL-06LR018P

HC LAB: NVLAP:200234-0; VCCI: R-341, C-354; NEMKO: ELA 113A; BSMI: SL2-IN-E-0037; SL2-R1-E-0037; CNLA: 1178; IC: IC4067

LT LAB: NVLAP:200234-0; VCCI: R-1435, C-1440; NEMKO: ELA 113B; BSMI: SL2-IN-E-0013; CNLA: 0997; IC: IC4164-1

EUT-3.

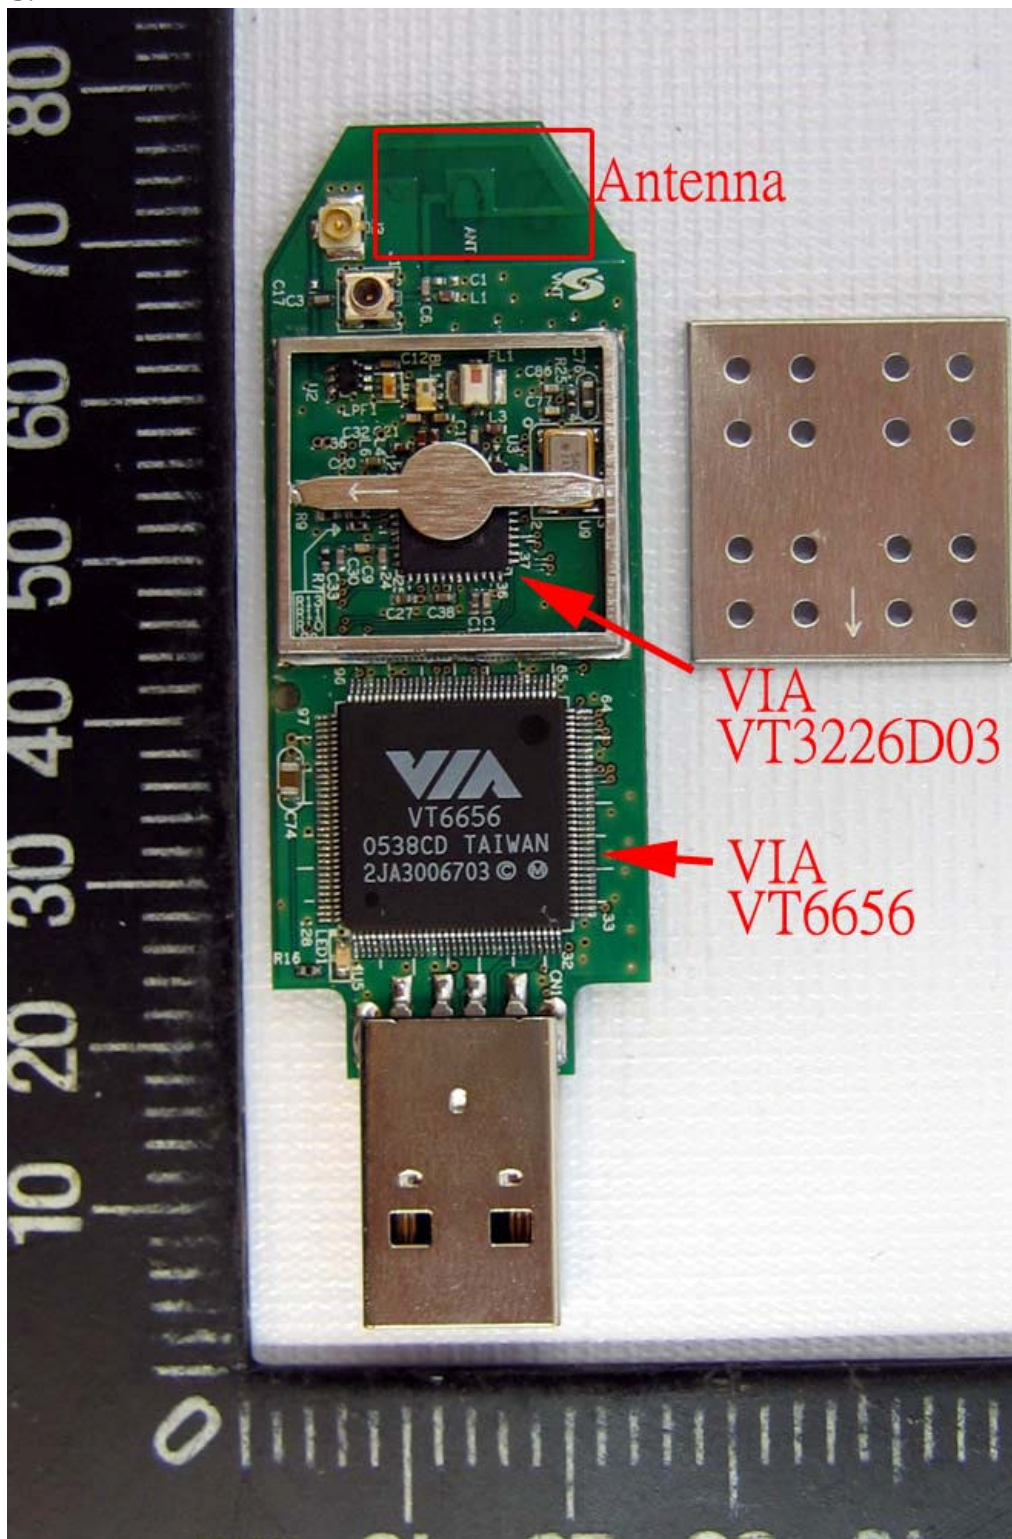

International Standards Laboratory

Report Number: ISL-06LR018P

HC LAB: NVLAP:200234-0; VCCI: R-341, C-354; NEMKO: ELA 113A; BSMI: SL2-IN-E-0037; SL2-R1-E-0037; CNLA: 1178; IC: IC4067

LT LAB: NVLAP:200234-0; VCCI: R-1435, C-1440; NEMKO: ELA 113B; BSMI: SL2-IN-E-0013; CNLA: 0997; IC: IC4164-1