




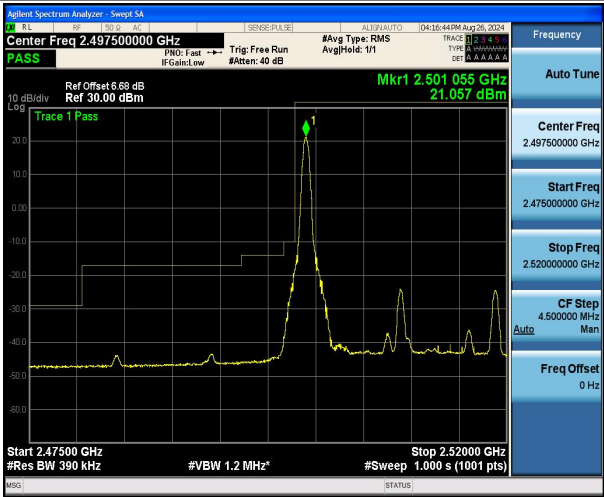

Band7\_20MHz\_QPSK\_20850\_1RB#0

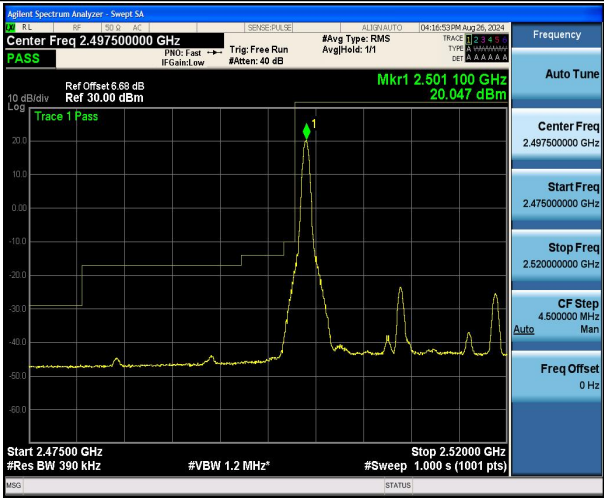



Band7\_20MHz\_16QAM\_20850\_1RB#0

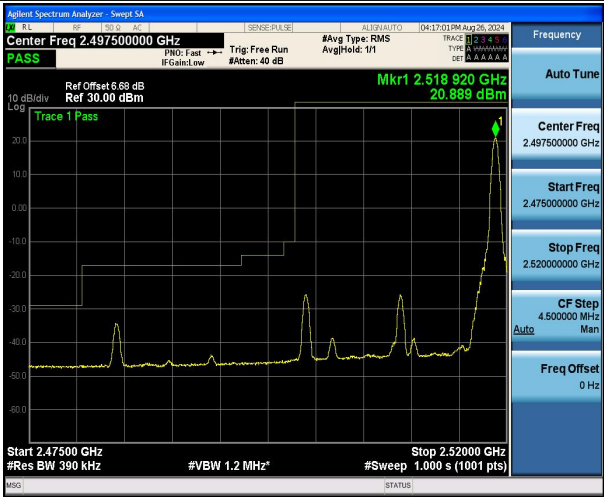

Band7\_20MHz\_QPSK\_20850\_1RB#99



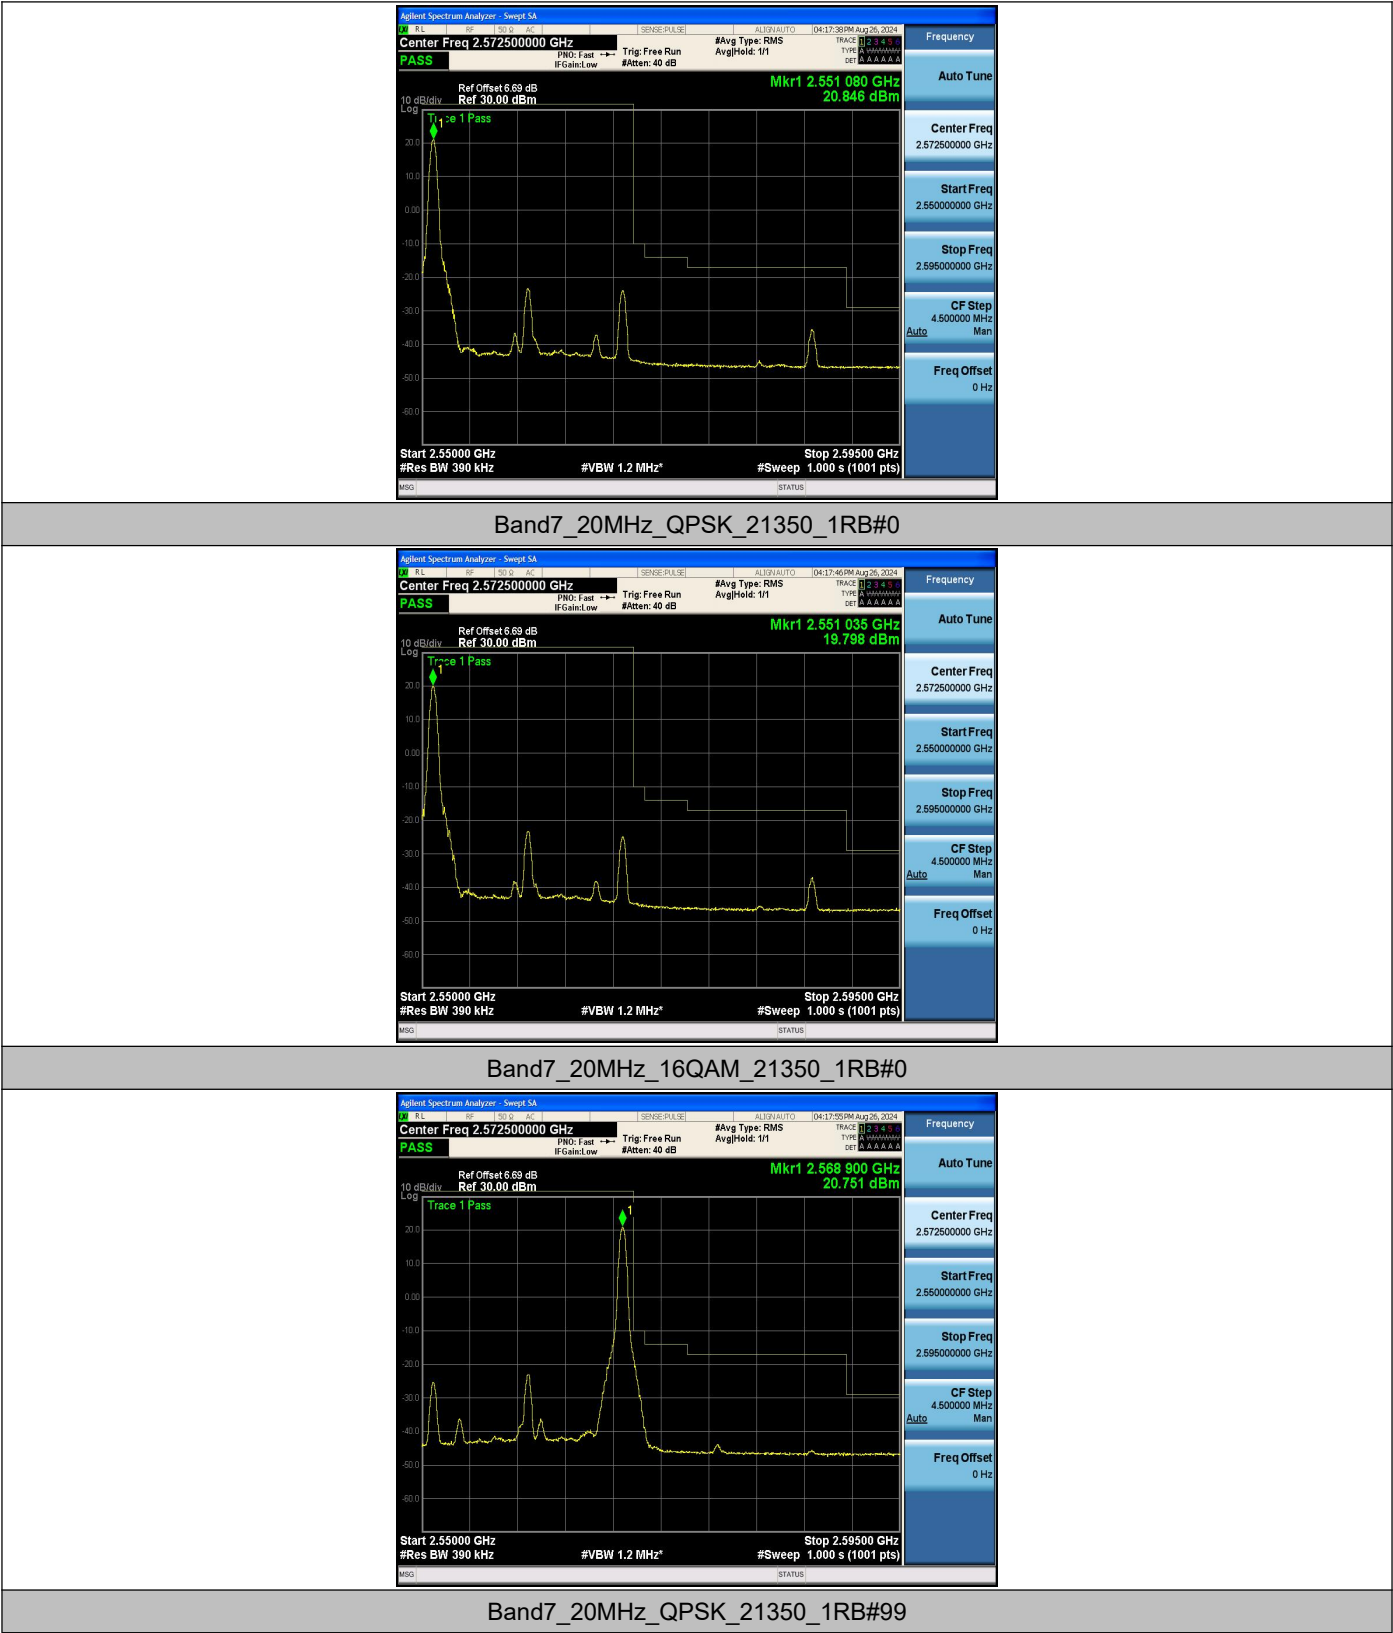

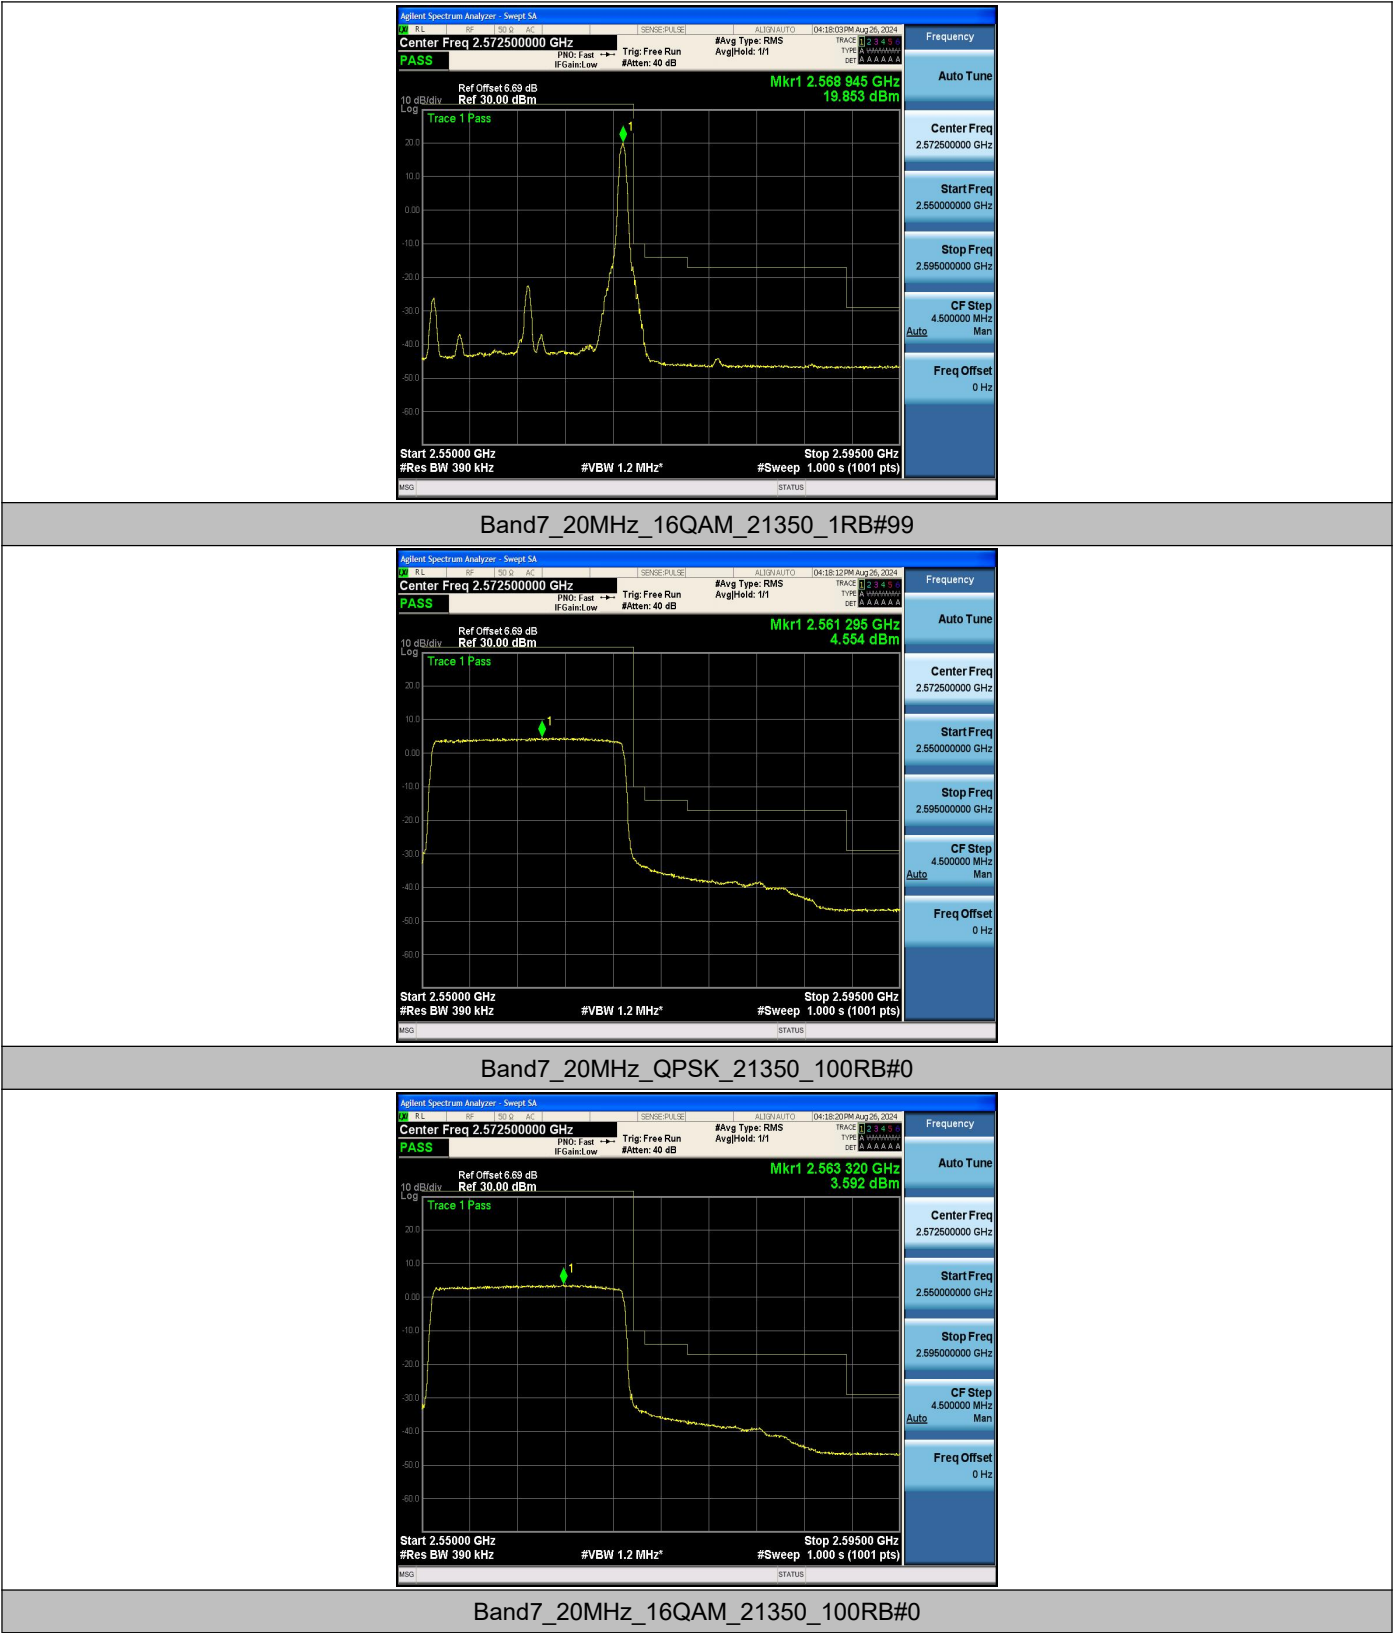



Band12\_1.4MHz\_QPSK\_23017\_1RB#0



Band12\_1.4MHz\_16QAM\_23017\_1RB#0



Band12\_1.4MHz\_QPSK\_23017\_1RB#5





Band12\_1.4MHz\_QPSK\_23173\_1RB#0




Band12\_1.4MHz\_16QAM\_23173\_1RB#0



Band12\_1.4MHz\_QPSK\_23173\_1RB#5



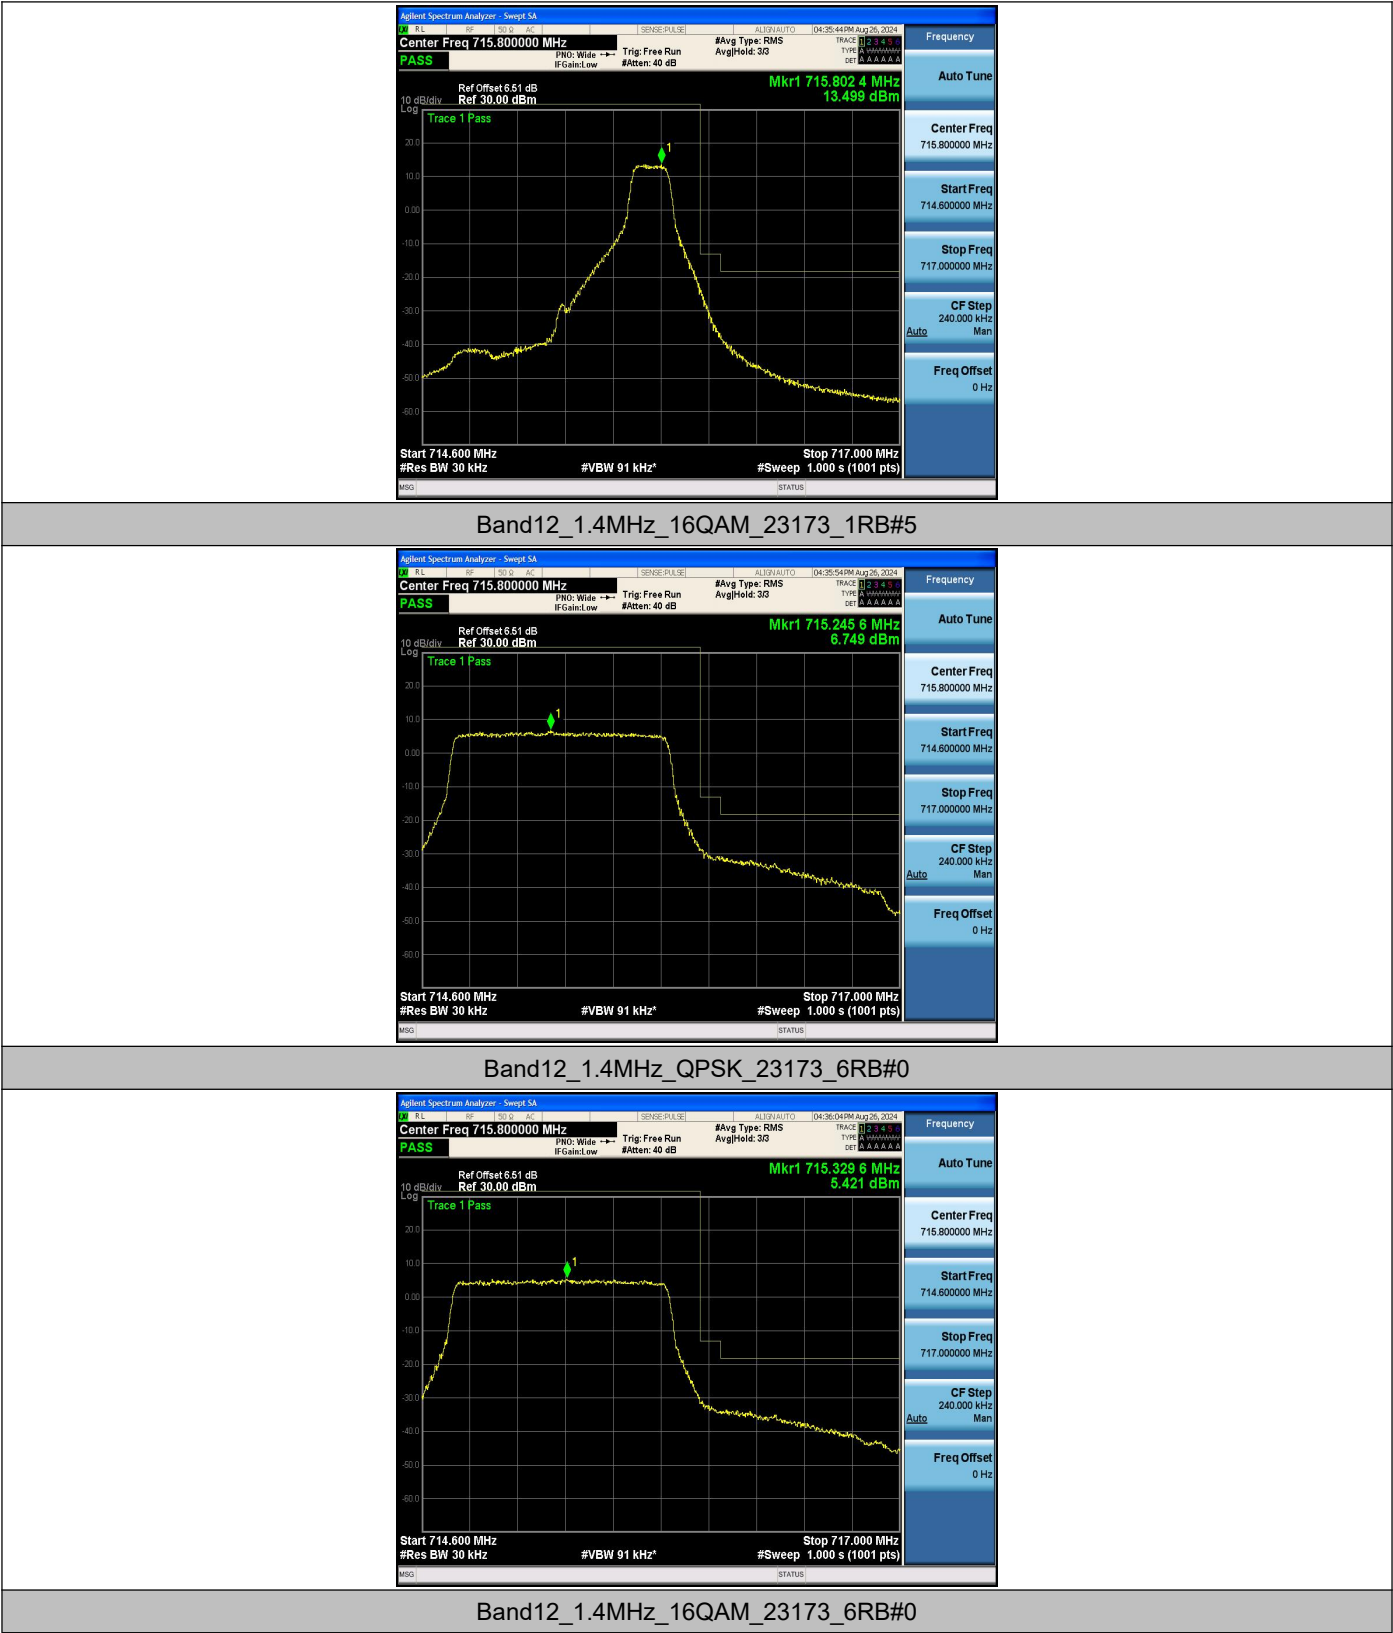

Agilent Spectrum Analyzer - Sweep SA

Center Freq 715.800000 MHz

PASS

Ref Offset 6.51 dB

Ref 30.00 dBm

Trace 1 Pass

Start 714.600 MHz

#Res BW 30 kHz

#VBW 91 kHz

Stop 717.000 MHz

#Sweep 1.000 s (1001 pts)

SENSE (PLA SE)

AL (10) AUTO

04:36:04 PM Aug 26, 2024

TYPE A

TYPE B

TYPE C

TYPE D

TYPE E

TYPE F

TYPE G

TYPE H

TYPE I

TYPE J

TYPE K

TYPE L

TYPE M

TYPE N

TYPE O

TYPE P

TYPE Q

TYPE R

TYPE S

TYPE T

TYPE U

TYPE V

TYPE W

TYPE X

TYPE Y

TYPE Z

Trig: Free Run

#Att: 40 dB

#Avg Type: RMS

Avg Hold: 30

Mkr1 715.329 6 MHz

5.421 dBm

Frequency

Auto Tune

Center Freq 715.800000 MHz

Start Freq 714.600000 MHz

Stop Freq 717.000000 MHz

CF Step 240.000 kHz

Auto


Freq Offset 0 Hz

Band12\_1.4MHz\_16QAM\_23173\_6RB#0






Band12\_3MHz\_QPSK\_23025\_1RB#0

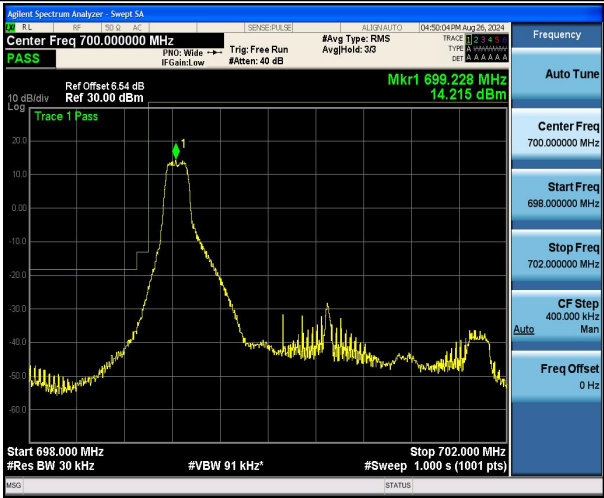

Band12\_3MHz\_16QAM\_23025\_1RB#0



Band12\_3MHz\_QPSK\_23025\_1RB#14

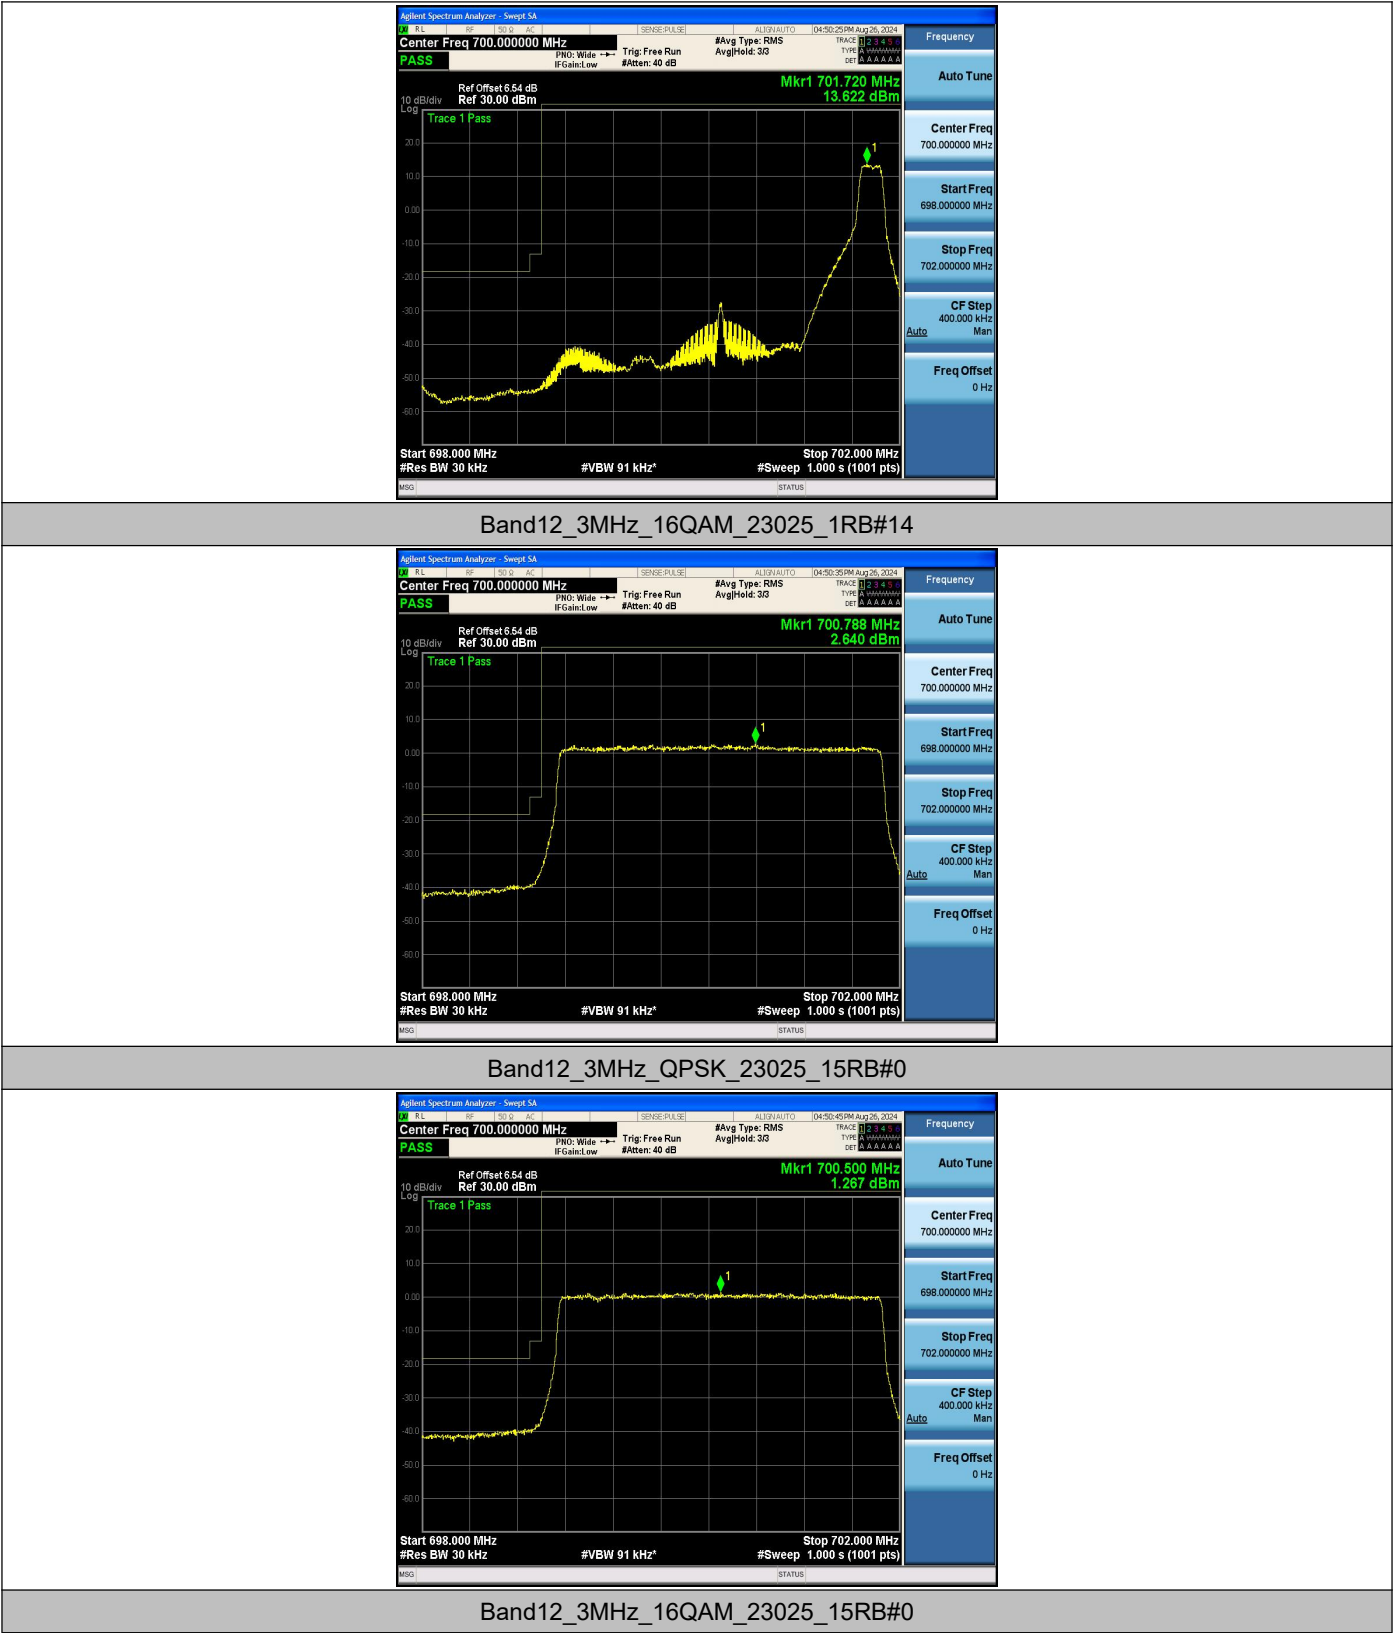

Agilent Spectrum Analyzer - Sweep SA

Center Freq 700.000000 MHz

Ref Offset 6.54 dB

Ref 30.00 dBm

Trace 1 Pass

Start 698.000 MHz

Stop 702.000 MHz

#Res BW 30 kHz

#VBW 91 kHz

#Sweep 1.000 s (1001 pts)

Frequency

Auto Tune

Center Freq 700.000000 MHz

Start Freq 698.000000 MHz

Stop Freq 702.000000 MHz

CF Step 400.000 kHz


Auto

Freq Offset 0 Hz

Mkr1 700.500 MHz

1.267 dBm

1

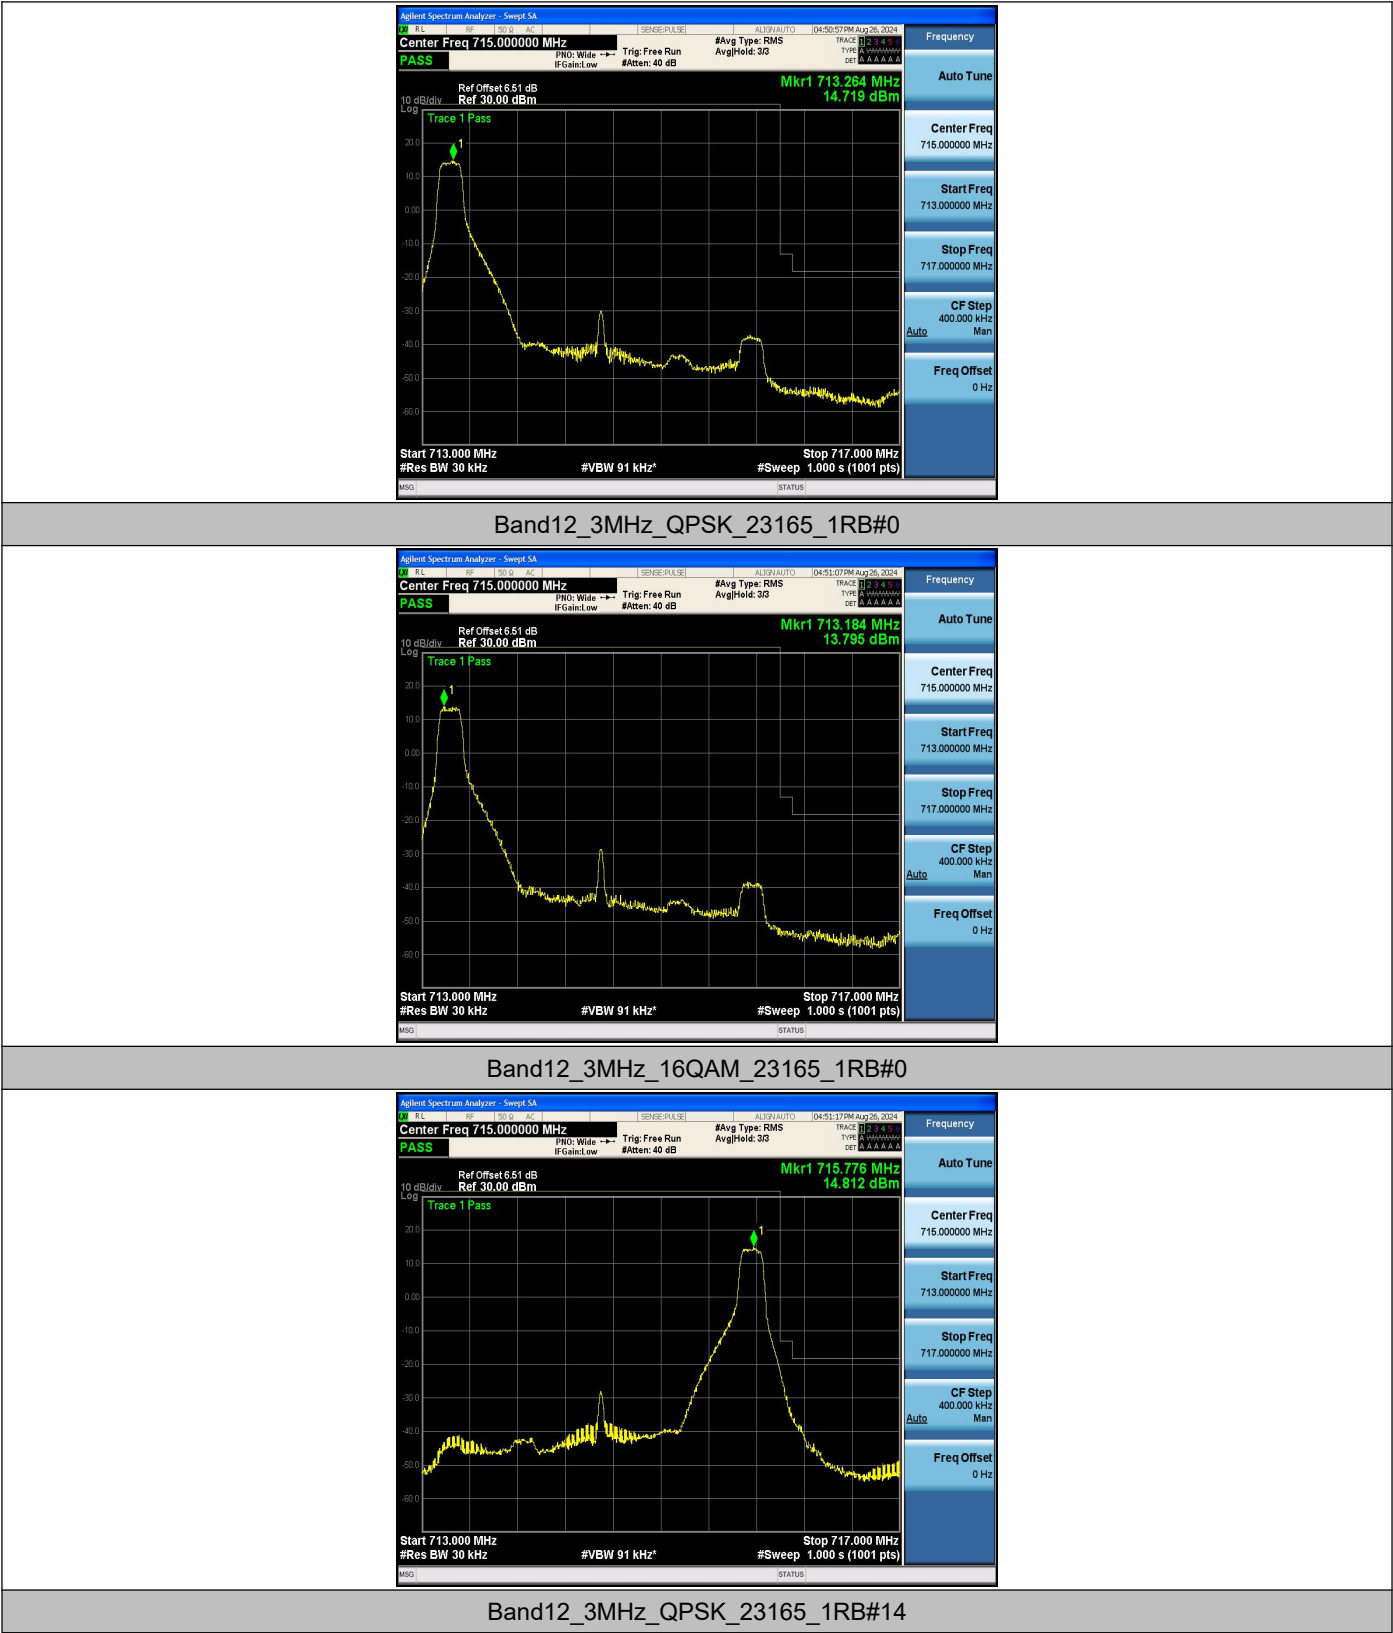



Agilent Spectrum Analyzer - Sweep SA

Center Freq 715.000000 MHz

PASS

Ref Offset 6.51 dB

Ref 30.00 dBm

Trace 1 Pass

Start 713.000 MHz

#Res BW 30 kHz

#VBW 91 kHz

Stop 717.000 MHz

#Sweep 1.000 s (1001 pts)

Frequency

Auto Tune

Center Freq 715.000000 MHz

Start Freq 713.000000 MHz

Stop Freq 717.000000 MHz

CF Step 400.000 kHz

Auto

Freq Offset 0 Hz

Mkr1 714.324 MHz

1.769 dBm

10 dB/div

Log

20.0

10.0

0.00

-10.0

-20.0


-30.0

-40.0

-50.0

-60.0

Band12\_3MHz\_16QAM\_23165\_15RB#0

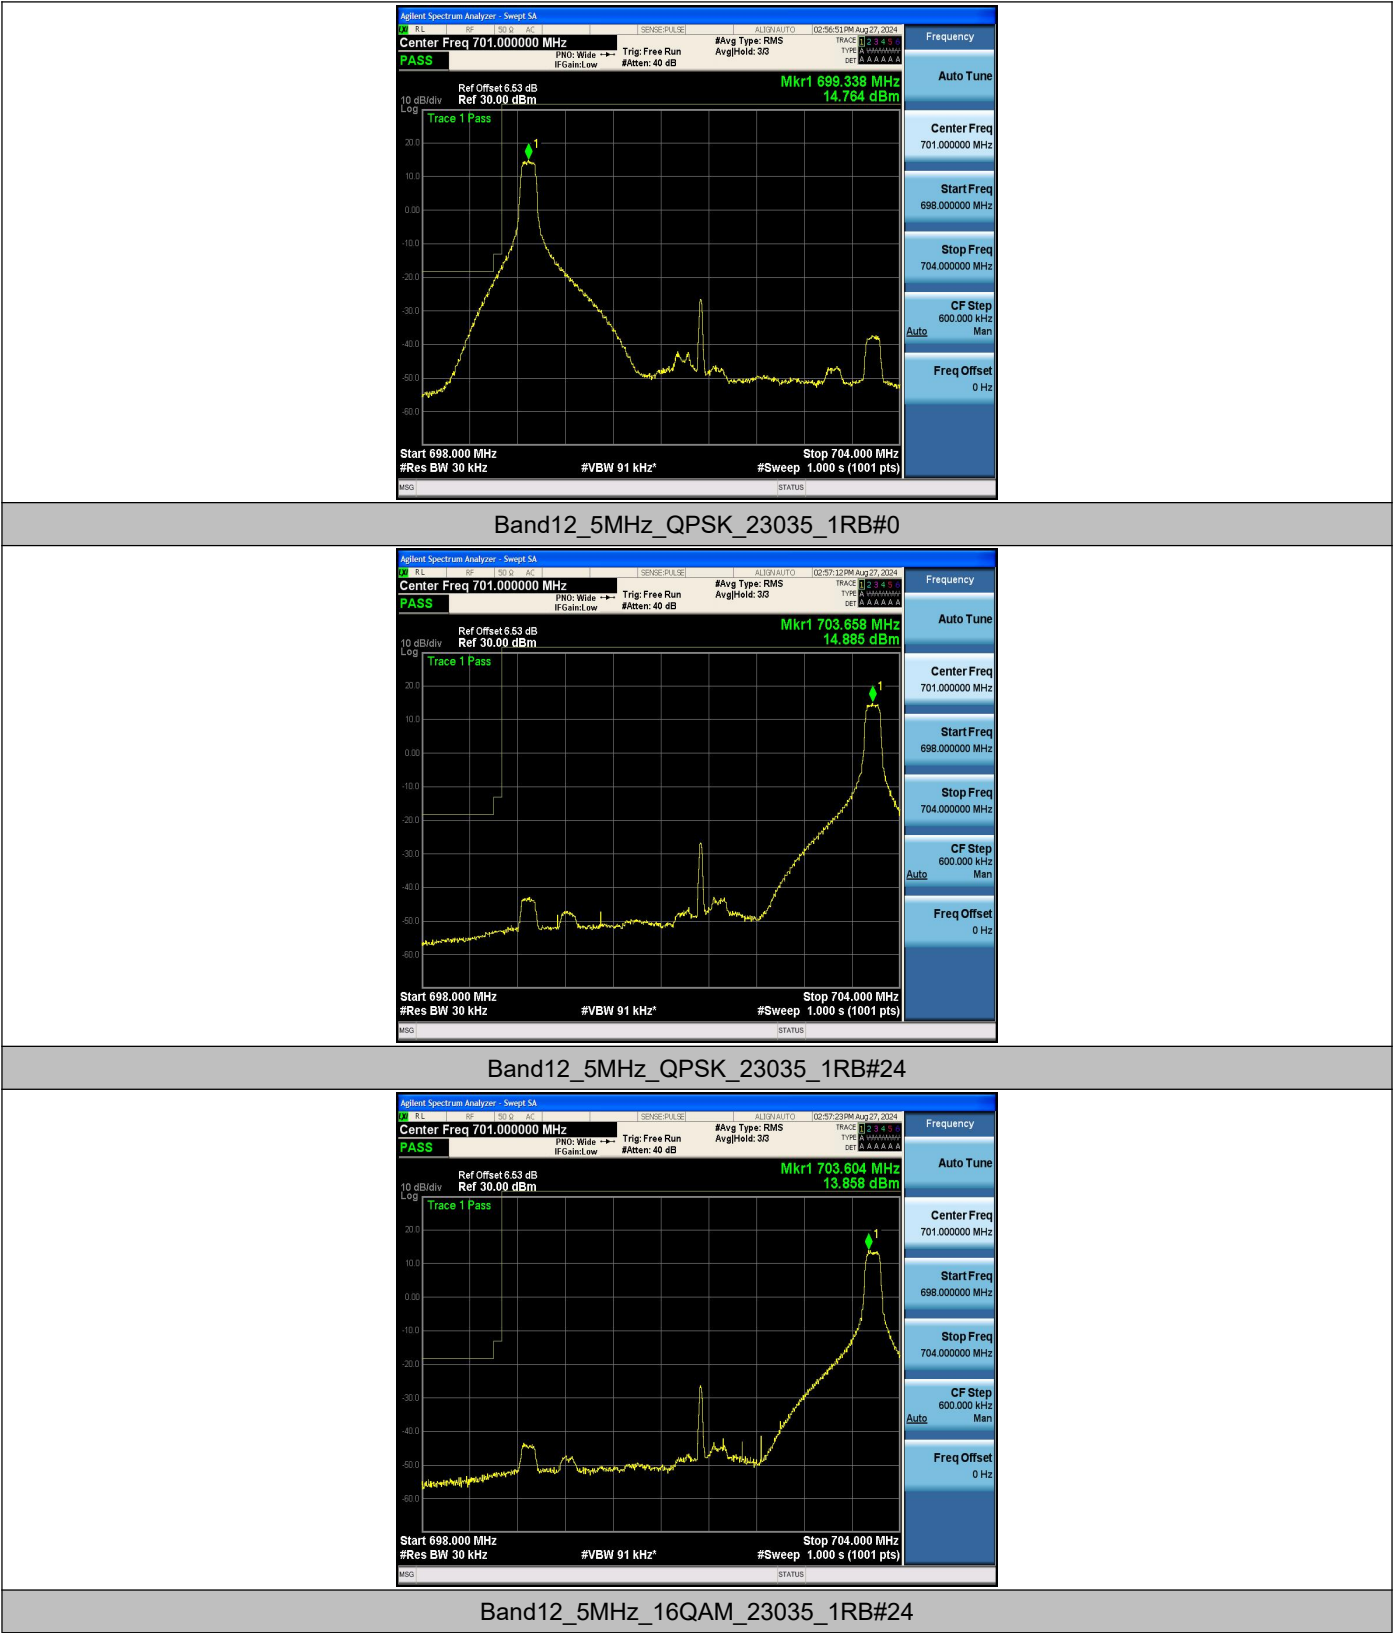

Agilent Spectrum Analyzer - Sweep SA

Center Freq 701.000000 MHz

PASS

Ref Offset 6.53 dB

Ref 30.00 dBm

Trace 1 Pass

Start 698.000 MHz

#Res BW 30 kHz

#VBW 91 kHz

Stop 704.000 MHz

#Sweep 1.000 s (1001 pts)

Mkr1 703.604 MHz

13.958 dBm

Frequency

Auto Tune

Center Freq 701.000000 MHz

Start Freq 698.000000 MHz

Stop Freq 704.000000 MHz

CF Step 600.000 kHz


Auto

Freq Offset 0 Hz

Band12\_5MHz\_16QAM\_23035\_1RB#24



Band12\_5MHz\_QPSK\_23035\_25RB#0

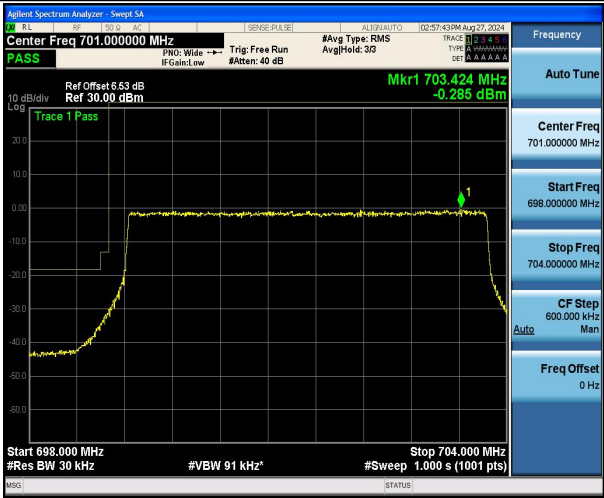

Band12\_5MHz\_16QAM\_23035\_25RB#0



Band12\_5MHz\_QPSK\_23155\_1RB#0



Band12\_5MHz\_16QAM\_23155\_1RB#0



Band12\_5MHz\_QPSK\_23155\_1RB#24



Band12\_5MHz\_16QAM\_23155\_1RB#24